

	<b>4" Oval Duct:</b> 100 CFM/1.0 Sone @ 0.1 SP, 14.5 Watts 84 CFM/1.5 Sones @ 0.25 SP, 17.7 Watts		
	(Additional specifications or notes)		

### Description

Low noise ceiling or wall mount ventilating fan, rated for continuous running. ENERGY STAR® qualified. HVI, UL and cUL certified to comply with ASHRAE 62.2 local and whole building continuous and intermittent operation. Meets CA Title 24 requirements.

### DC Motor/Blower

- Power rating of 120 volts/60Hz
- Motor equipped with thermal cutoff fuse
- Removable with permanently lubricated plug-in motor
- Built-in soft start function to increase bearings' life
- Automatically powers OFF when impeller is locked abnormally

### Housing

- Galvanized steel body
- Detachable 4" oval metal duct adapter
- Built-in backdraft damper
- Includes 4" oval duct to 3" round duct reducer
- Easy installation

### Grille

- Attractive design using ABS material
- Attaches directly to housing with torsion springs

### LED Indicator


- Turn the power switch on/off to operate on/off. LED indicator will be green when power is on

### Warranty


- 3-Year limited warranty

### TYPICAL SPECIFICATION

Ventilation fan shall be Delta Breez model SLM100; ENERGY STAR qualified with Brushless DC Motor engineered to run continuously for a minimum 70,000 hours; airflow rating of 100 CFM and loudness rating of 1.0 Sone at 0.1 static pressure as certified by the Home Ventilating Institute (HVI); power consumption of 14.5 Watts with efficiency rating of 6.8 CFM/Watt; fan will feature LED indicator running light and motor lock protection. UL and cUL listed for tub/shower enclosure when used with GFCI-protected branch circuit wiring

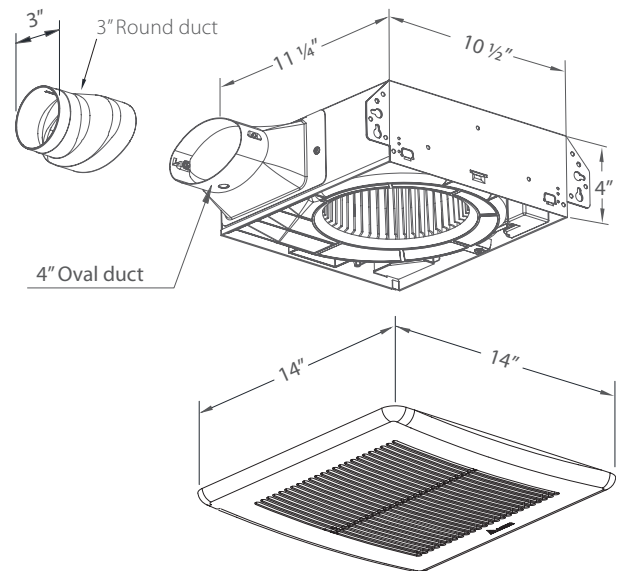

Fan Curve SLM100 with 4" Oval Duct

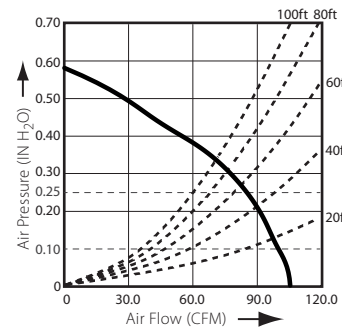

SLM100	4" oval duct	
Static Pressure (inches w.g.)	0.1	0.25
Air Flow (CFM)	100	84
Sones	1.0	1.5
Power Consumption (Watts)	14.5	17.7
Energy Efficiency (CFM/Watt)	6.8	4.7
Current (Amps)	0.3 Max	
Power Rating (V/Hz)	120/60	

Model	Quantity	Comments	Project:
			Location:
			Architect:
			Engineer:
			Contractor:
			Submitted by:
			Date: