



(Fan with Dual Speed - 70 CFM)

	Continuous Low Speed:	Full Speed:		
	40 CFM/0.8 Sones @ 0.1" SP, 5.0 Watts 25 CFM/1.0 Sones @ 0.25" SP, 6.0 Watts	70 CFM/2.0 Sones @ 0.1" SP, 13.2 Watts 50 CFM/1.5 Sones @ 0.25" SP, 11.6 Watts		

Description

Low noise ceiling/wall mount ventilating fan with continuous low speed and full speed mode. Fan has been awarded ENERGY STAR® qualified. It is HVI, UL, and cUL certified, and can be used to comply with ASHRAE 62.2 (local and whole building intermittent operation), CA Title 24 requirements.

DC Motor/Blower

- Power rating of 120 volts/60Hz
- Brushless DC motor engineered to run continuously
- Motor equipped with thermal cutoff fuse
- Removable with permanently lubricated plug-in motor
- Built-in soft start function to increase bearings' life
- Automatically powers OFF when impeller is locked abnormally

Housing

- Galvanized steel body
- Detachable 3" diameter plastic duct adapter
- Built-in backdraft damper
- Easy installation

Grille

- Attractive design using ABS material
- Attaches directly to housing with torsion springs

LED Indicator


- Green and amber LED indicator lights to show continuous low speed and full speed modes

Warranty


- 3-Year limited warranty

TYPICAL SPECIFICATION

Ventilation fan shall be Delta Breez model SLM70D; ENERGY STAR qualified with DC brushless motor engineered to run continuously for a minimum 70,000 hours; airflow rating of 70 CFM and loudness rating of 2.0 Sones at 0.1 static pressure as certified by the Home Ventilating Institute (HVI); power consumption of not more than 13.2 Watts with efficiency rating of 7.1 CFM/Watt. UL and cUL listed for tub/shower enclosure when used with GFCI-protected branch circuit wiring.

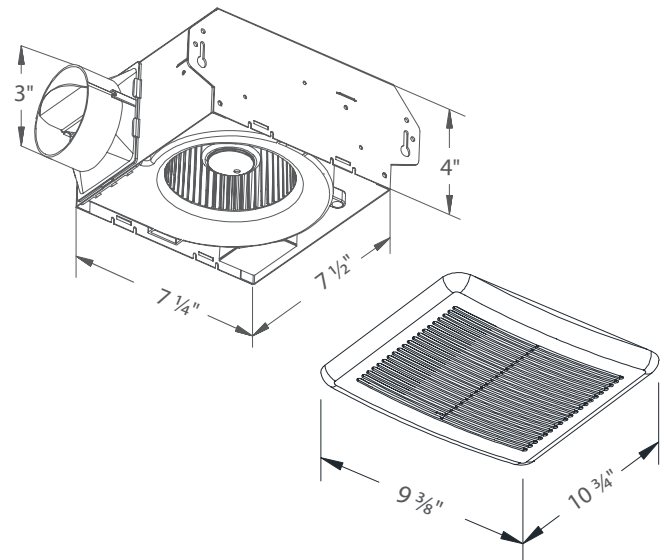

BreezSlim SLM70D				
	Continuous low speed		Full speed	
Static Pressure (Inches w.g.)	0.1	0.25	0.1	0.25
Air Flow (CFM)	40	25	70	50
Sones	0.8	1.0	2.0	1.5
Power Consumption (Watts)	5.0	6.0	13.2	11.6
Energy Efficiency (CFM/Watts)	12.9	6.3	7.1	6.2
Current (Amps)	0.29 Max			
Power Rating (V/Hz)	120/60			

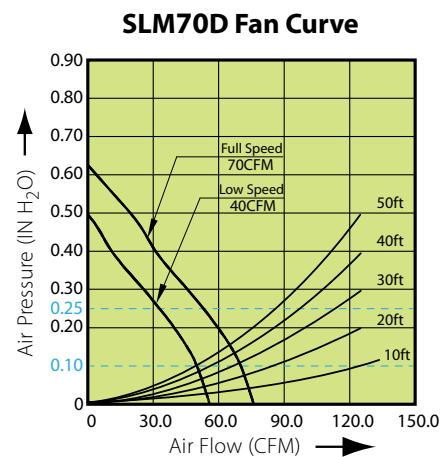

Model	Quantity	Comments	Project:
			Location:
			Architect:
			Engineer:
			Contractor:
			Submitted by:
			Date: