



**6" Duct (Standard):**

150 CFM/<0.3 Sones @ 0.1 SP, 16.9 Watts  
149 CFM/1.3 Sones @ 0.25 SP, 23.7 Watts



**Description**

Low noise ceiling mount ventilating fan rated for continuous running. ENERGY STAR® qualified; HVI, UL and cUL certified to comply with ASHRAE 62.2 local and whole building continuous and intermittent operation. Meets CA Title 24 requirements.

**DC Motor/Blower**

- Power rating of 120 volts/60Hz
- Brushless DC motor engineered to run continuously
- Motor equipped with thermal cutoff fuse
- Removable with permanently lubricated plug-in motor
- Built-in soft start function to increase bearings' life
- Automatically powers off when impeller is locked abnormally
- Self-compensating motor speed for intended airflow when static pressure is encountered

**Housing**

- Galvanized steel body
- Detachable 6" diameter metal duct adapter
- Built-in backdraft damper
- Hanger bars included
- Easy installation

**Grille**


- Attractive design using ABS material
- Attaches directly to housing with torsion springs

**Warranty**


- 3-Year limited warranty

**TYPICAL SPECIFICATION**

Ventilation fan shall be Delta Breez model SMT150; ENERGY STAR qualified with Brushless DC Motor engineered to run continuously for a minimum 70,000 hours; airflow rating of 150 CFM and loudness rating of <0.3 Sones at 0.1 static pressure as certified by the Home Ventilating Institute (HVI); power consumption of 16.9 Watts with efficiency rating of 8.8 CFM/Watt at 0.1" static pressure; motor lock protection and self-compensating motor speed for intended airflow when static pressure is encountered. UL and cUL listed for tub/shower enclosure when used with GFCI-protected branch circuit wiring

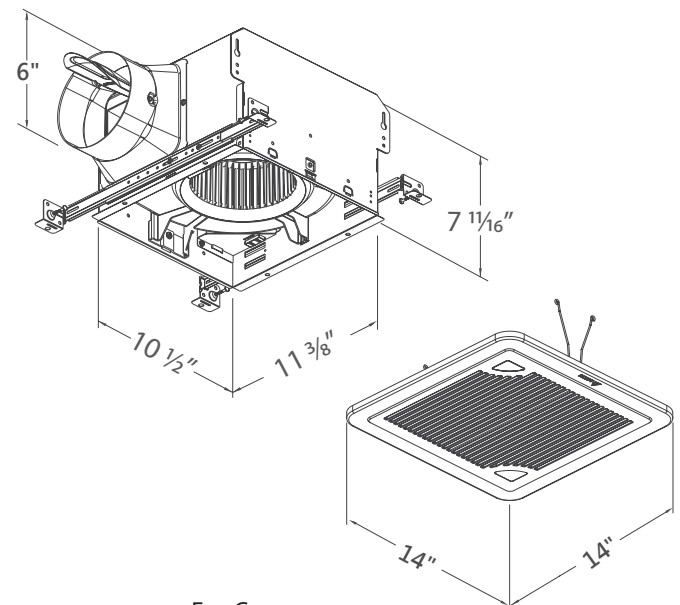

Fan Curve

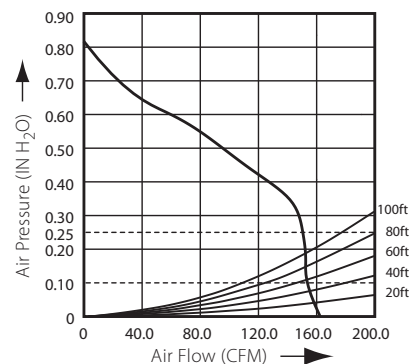

BreezSmart SMT150	6" Duct(Standard)	
Static Pressure (inches w.g.)	0.1	0.25
Air Flow (CFM)	150	149
Sones	<0.3	1.3
Power Consumption (Watts)	16.9	23.7
Energy Efficiency (CFM/Watt)	8.8	6.2
Current (Amps)	0.47 Max	
Power Rating (V/Hz)	120/60	

Model	Quantity	Comments	Project:
			Location:
			Architect:
			Engineer:
			Contractor:
			Submitted by:
			Date: