



(Fan/Dimmable LED Light- 80 CFM)



4" Duct (Standard):
 80 CFM/1.5 Sones @ 0.1 SP, 14.5 Watts
 65 CFM/2.0 Sones @ 0.25 SP, 14.5 Watts



Description

Low noise ceiling mount ventilating fan/Dimmable LED light rated for continuous running. Fan has been awarded ENERGY STAR®. It is HVI, UL, and cUL certified, and can be used to comply with ASHRAE 62.2 local and whole building continuous and intermittent operation. Meets CA Title 24 requirements.

DC Motor/Blower

- Power rating of 120 volts/60Hz
- DC brushless motor engineered to run continuously
- Motor equipped with thermal cutoff fuse
- Removable with permanently lubricated plug-in motor
- Built-in soft start function to increase bearings' life
- Automatically powers OFF when impeller is locked abnormally

Housing

- Galvanized steel body
- Detachable 4" diameter metal duct adapter
- Built-in backdraft damper
- Easy installation with expandable extension bracket

Grille

- Attractive design using PP material
- Attaches directly to housing with torsion springs

Light



- 13-Watt Dimmable LED main light included (dimmer switch not included)
- Main light output 850 Lumens, 3000K and 90 CRI

Warranty

- 3-year limited warranty

TYPICAL SPECIFICATION

Ventilation fan shall be Delta Breez model 80LED-REC; ENERGY STAR qualified with DC brushless motor engineered to run continuously for a minimum 70,000 hours; airflow rating of 80 CFM and loudness rating of 1.5 Sones at 0.1 static pressure as certified by the Home Ventilating Institute (HVI); power consumption of 14.5 Watts with efficiency rating of 6.1 CFM/Watt; fan will feature motor lock protection. UL and cUL listed for tub/shower enclosure when used with GFCI-protected branch circuit wiring.

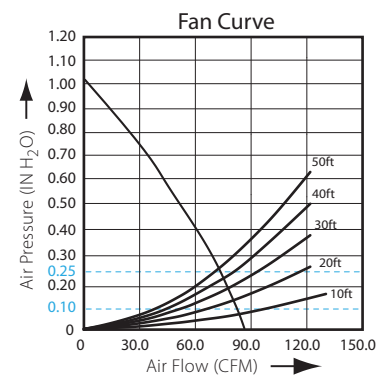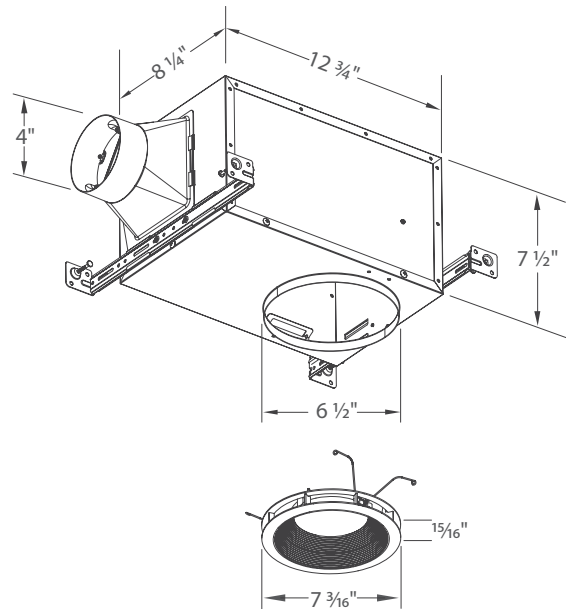

BreezRecessed 80LED-REC	4" Duct (Standard)	
Static Pressure (inches w.g.)	0.1	0.25
Air Flow (CFM)	80	65
Sones	1.5	2.0
Power Consumption (Watts)	14.5	14.5
Energy Efficiency (CFM/Watt)	6.1	5.4
Current (Amps)	0.34 Max	
Power Rating (V/Hz)	120 / 60	
LED Main Light (Watt)	13	

Model	Quantity	Comments	Project:
			Location:
			Architect:
			Engineer:
			Contractor:
			Submitted by:
			Date: